

SD10244XXX, PT RTD probe sensor

Features / Applications :


- Features:
 - Low drift
 - Long service life
 - Wide temperature range
 - Wide range of resistance values
 - Temperature linear control
 - High precision
 - Fast response time
 - RoHS compliant

- Appliances:
 - Home Appliances: Oven



Electrical Specifications :

Characteristics	Feature
Resistance value at 0°C	1000±4.0 Ω
Temperature coefficient of resistance (TCR)	3750ppm/°C
Operation Temperature Range	-40°C~ +538°C
Maximum ambient on sensor	593°C
Maximum Applied current	2 mA

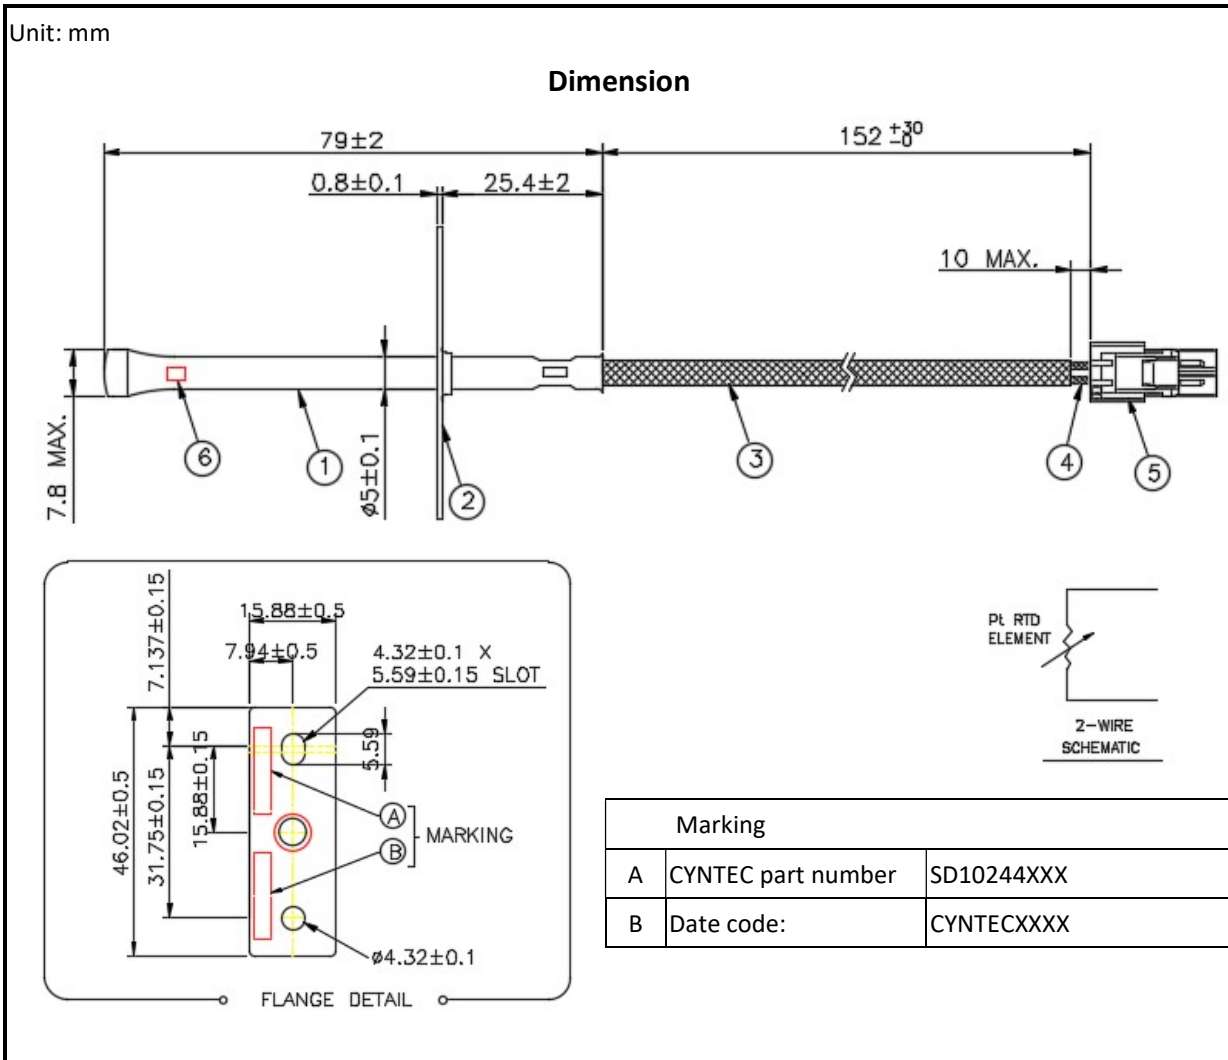Outline Drawing :

Outline Specifications :

No.	Material	Specification
①	Probe tube	Φ5XL79 mm, material: 300 series stainless steel tube. Discoloration due to welding and high temperature testing is acceptable.
②	Flange	Material: 300 series stainless steel.
③	Fiberglass sleeving	This sleeve is #11 size with a minimum wall thickness of 0.012 and is rated up to 1200°F.

④	Lead wire	24 AWG nickel plated stranded copper with fiberglass insulation over each.
⑤	Connector	Terminal: TE 175151-2 Housing: TE 176271-1
⑥	Sensor element	1000 ohms thin film platinum RTD, alpha(TCR)= 3750 ppm/°C ESD sensitivity level: ±2KV

Type Designation :

SD 102 4 4 XXX
(1) (2) (3) (4) (5)

Where:

- (1) Series No: SD= PT probe
- (2) Resistance Value: 102=500=500 ohm
- (3) TCR/Class: 4 = 3750/C
- (4) Package type : 4 = Metal tube type
- (5) Serial no

Characteristics :

Electrical

Item	Specification and Requirement	Test Method
Dielectric strength	Current leakage<1mA No breakdown.	Apply 1250 VAC between the lead wires and stainless steel tube for 1 second at room temperature.
Insulation resistance	>50 Megohms	Apply 50 VDC between the leads wire and stainless steel tube for 1 second.
Short time overload	$\Delta R(0 \text{ degree}) \leq 0.24\%$ Without distinct damage in appearance.	Repeat 10 cycles as follow: Apply current: 5mA rated current for 5 seconds and 30 seconds at room temperature.
ESD	$\Delta R(0 \text{ degree}) \leq 0.24\%$	Human body, 2KV.

Mechanical

Item	Specification and Requirement	Test Method
Flange pull force	>8 Kgf	Apply axial pull force on the flange assembled in probe housing.
Wire pull out force	>5.4 Kgf	Apply axial pull out force on the leads wire in probe housing.
Crimping pull out force	>3.0 kgf	Fix the crimped terminal to the jig, apply axial pull out force on the wire at the speed rate of 100 mm/minute

Endurance

Item	Specification and Requirement	Test Method
Low temperature test	$\Delta R(0 \text{ degree}) \leq 0.24\%$ Without distinct damage in appearance.	(1) Keep the probe sensor in -55°C for 1000 hours.
High temperature test	$\Delta R(0 \text{ degree}) \leq 0.24\%$ Without distinct damage in appearance.	Keep the probe sensor in 538°C for 1000 hours.
Humidity test	$\Delta R(0 \text{ degree}) \leq 0.24\%$ Without distinct damage in appearance.	Keep the probe sensor in 60°C and 90%~95% R.H. for 1000 hours.
Thermal cycles	$\Delta R(0 \text{ degree}) \leq 0.24\%$ Without distinct damage in appearance.	(1) Keep the probe sensor in 538°C for 3 hours. (2) keep the probe sensor in 70°C for 30 minutes. Repeat (1)~(2) for 150 cycles.
Thermal shock	$\Delta R(0 \text{ degree}) \leq 0.24\%$ Without distinct damage in appearance.	(1) Keep the probe sensor in 538°C for 10 minutes. (2) Keep the probe sensor in room temperature for 5 minutes. Repeat (1)~(2) for 250 times.

Temperature and resistance relationship:

- The temperature and resistance relationships used in this standard are as follows:

When $T < 0^{\circ}\text{C}$:

$$R_t = R_0 [1 + aT + bT^2 + cT^3 (T - 100)]$$

When $T \geq 0^{\circ}\text{C}$:

$$R_t = R_0 (1 + aT + bT^2)$$

Where

R_t : resistance at a certain temperature T


R_0 : resistance at 0°C

a, b, c : coefficient (refer to the following table)

Coefficient for $\text{TCR}=3750 \text{ PPM}/^{\circ}\text{C}$

Temperature	a	b	c
$T < 0^{\circ}\text{C}$	3.81019E-03	-6.01875E-07	-6.14500E-12
$T \geq 0^{\circ}\text{C}$	3.81019E-03	-6.01875E-07	0

- Temperature – Resistance Diagram

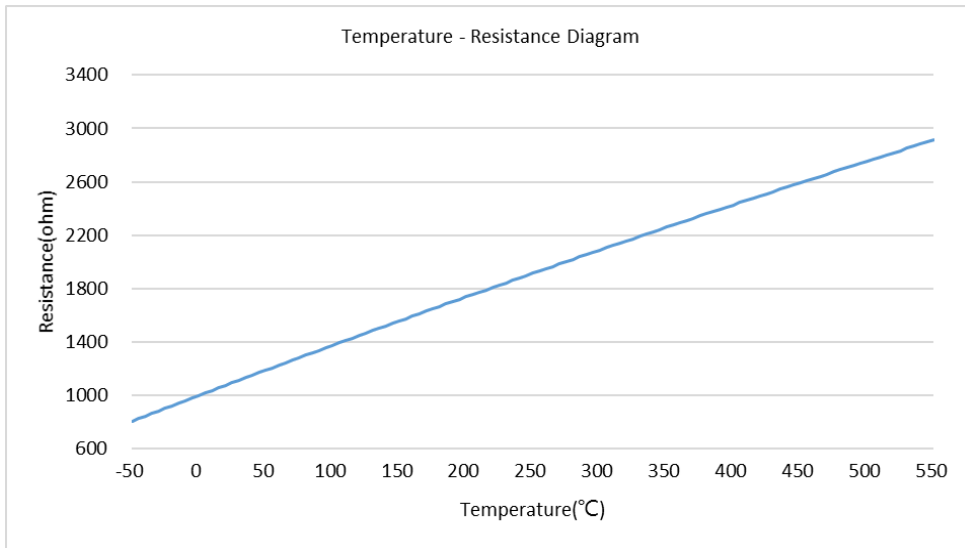

Certificate :

- The probe sensor recognized by Underwriters Laboratories
UL component listing: UL file # E158992