


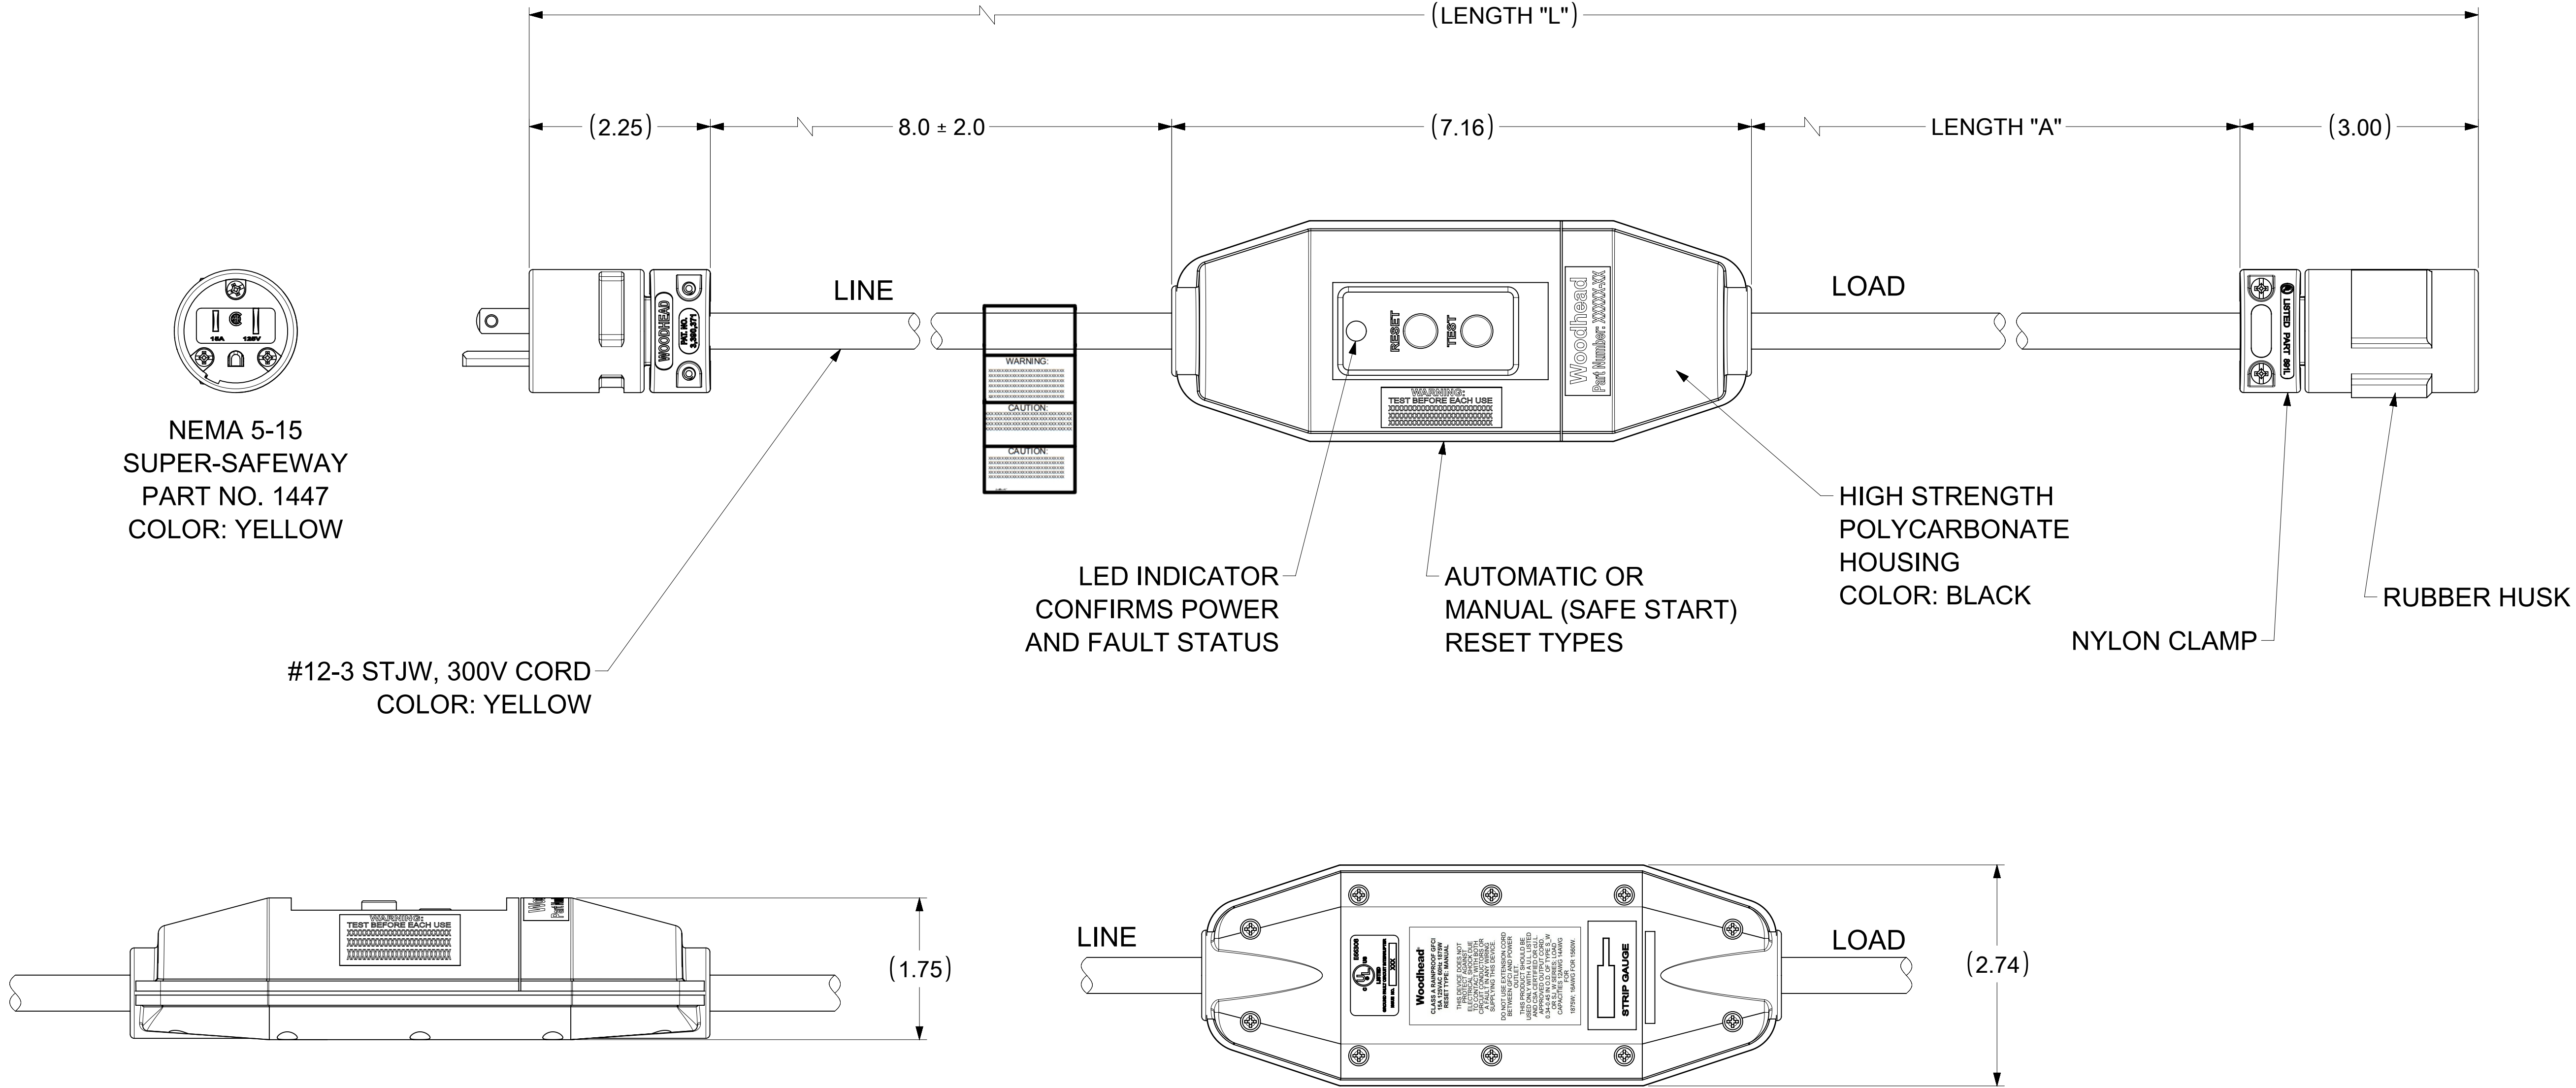

TECHNICAL:
LISTED: cULus
RATED SUPPLY VOLTAGE: 120 VAC
RATED CURRENT: UP TO 15 AMPS OR CABLE RATING
RESET TYPE: AUTOMATIC OR MANUAL
OPERATING FREQUENCY: 60 Hz
TYPE: CLASS A
GROUND TRIP CURRENT: 4-6 mA
OVERLOAD CURRENT: 90 AMP 125 VAC
INSULATION VOLTAGE: 1,500 VRMS - 1 MINUTE
ENDURANCE OPERATIONS: 3000 OPERATIONS

MATERIAL NO.	ENGINEERING NO.	LENGTH "L"	LENGTH "A"	POWER-UP
1301530043	15051-1A	2 FT 7 IN	1 FT ± 1 IN	AUTO
1301530052	15051-6A	7 FT 7 IN	6 FT ± 2 IN	AUTO
1301530046	15051-25A	26 FT 7 IN	25 FT ± 2 IN	AUTO
1301530049	15051-50A	51 FT 7 IN	50 FT ± 4 IN	AUTO
1301530044	15051-1M	2 FT 7 IN	1 FT ± 1 IN	MANUAL
1301530053	15051-6M	7 FT 7 IN	6 FT ± 2 IN	MANUAL
1301530047	15051-25M	26 FT 7 IN	25 FT ± 2 IN	MANUAL
1301530050	15051-50M	51 FT 7 IN	50 FT ± 4 IN	MANUAL

FUNCTIONAL SYMBOLS		THIS DRAWING CONTAINS INFORMATION THAT IS PROPRIETARY TO MOLEX ELECTRONIC TECHNOLOGIES, LLC AND SHOULD NOT BE USED WITHOUT WRITTEN PERMISSION																	
		DIMENSION UNITS		SCALE		CURRENT REV DESC: MIGRATION TO ECTR/NX				<div>molex</div>									
<div><div>F</div><div>A</div><div>=</div><div>0</div></div>		INCH		NTS															
<div><div>F</div><div>C</div><div>=</div><div>0</div></div>		GENERAL TOLERANCES (UNLESS SPECIFIED)																	
<div><div>F</div><div>P</div><div>=</div><div>0</div></div>		ANGULAR TOL		± 0.5 °		EC NO: 684571				120V 15A INLINE GFCI W/ 1447 & 1547 NEMA 5-15									
DIVISIONAL SYMBOLS		4 PLACES		±		DRWN: VBASUTHKARP 2021/11/08													
		3 PLACES		±		CHK'D: DNGUYEN62 2022/01/20													
		2 PLACES		± 0.13		APPR: HKNEELAND 2022/02/02													
		1 PLACE		± 0.25		INITIAL REVISION:													
		0 PLACES		±		DRWN: HRUIZ01 2013/02/06													
				APPR: JFMURPHY 2015/04/20															
		DRAFT WHERE APPLICABLE MUST REMAIN WITHIN DIMENSIONS				THIRD ANGLE PROJECTION		DRAWING		SERIES		DOCUMENT NUMBER		DOC TYPE		DOC PART		REVISION	
								D-SIZE		130153		SD-130153-015		PSD		001		A1	
												SEE TABLE		GENERAL MARKET		SHEET NUMBER		1 OF 1	

DOCUMENT STATUS	P1	RELEASE DATE	2022/02/02	16:39:36
-----------------	----	--------------	------------	----------