
POWER-UNITS No.53A AND No.53B
10V 0·25A DC
SUPPLY FROM 50Hz AC MAINS

N 631
ISSUE E

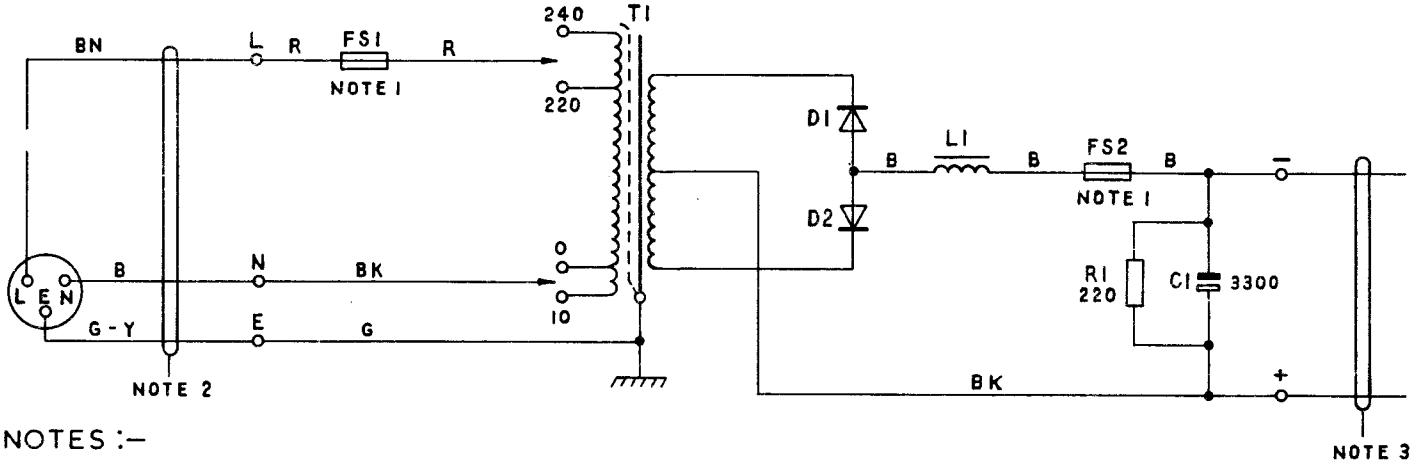

NOTES :–

1. FS1 – FUSE No.36A/0·1 FS2 – FUSE No.36/0·5

2. CORD FLEXIBLE 3183Y 0·75mm² AND BS 3 PIN PLUG TO SUIT SOCKET TO BE REQUISITIONED SEPARATELY AND FITTED LOCALLY FUSED PLUGS TO BE FITTED WITH 3 AMP FUSES

3. CABLE DISTRIBUTION 3595 REQUISITIONED SEPARATELY AND FITTED LOCALLY

4. THE OUTPUT MUST NOT BE EARTHED

PO TELECOMMS HQRS PAPER :-W DISTN :- GENERAL			
	E	NEW FORMAT. TRANSFORMER 200V TAPPING REMOVED WIRE COLOURS AND CAPACITOR VALUE CHANGED. NOTES 2&3 AMENDED . NOTE 4 ADDED. 53B INTRODUCED D.L.W. TD 7.2.3	12·4·77
	D	NEW FORMAT KMA	12·7·66